



SOIL ANALYSIS

GEOTECHNICAL & MATERIALS
ENGINEERING, TESTING & INSPECTION
P.O. BOX 15732 - TAMPA, FLORIDA 33604 - 813/572-7821 CA No.1450

PROJECT: Product Check - P.O. No. 7001-95000
53rd Street Yard

PROJECT NO: TL-8047

CLIENT: Transcor Recycling LLC

DATE: 12/31/2018

LAB NO.: B-11338

SAMPLE LOCATION: Stockpile

SAMPLE DESCRIPTION: Crushed Concrete
(Base Material)

<u>Sieve Number</u>	<u>Percent Passing</u>	<u>Material Type B-12 FDOT Specifications Uncertified</u>
2"	100	100
1"	97	—
3/4"	90	65-95
3/8"	75	40-85
No. 4	58	25-65
No.10	44	20-50
No. 50	21	5-30
No. 100	9	—
No. 200	4.3	0-10

DATE SAMPLED: 12/21/2018

DATE TESTED: 12/26/2018



SA.Lab#B-11338

This report contains information that is intended solely for the use of the client and should not be reproduced, except in full, without written approval of Test Lab, Inc.



GEOTECHNICAL & MATERIALS
ENGINEERING, TESTING & INSPECTION

P.O. BOX 15732 - TAMPA, FLORIDA 33684 - 813/872-7821 CA No. 1480

PROJECT: Product Check - P.O. No. 7001-95000
53rd Street Yard

CLIENT: Transcor Recycling LLC


LIMEROCK BEARING RATIO TEST

TEST METHOD: FDOT FM 5-515

PROJECT NO: TL-8047

DATE: December 31, 2018

LAB NO: B-11338

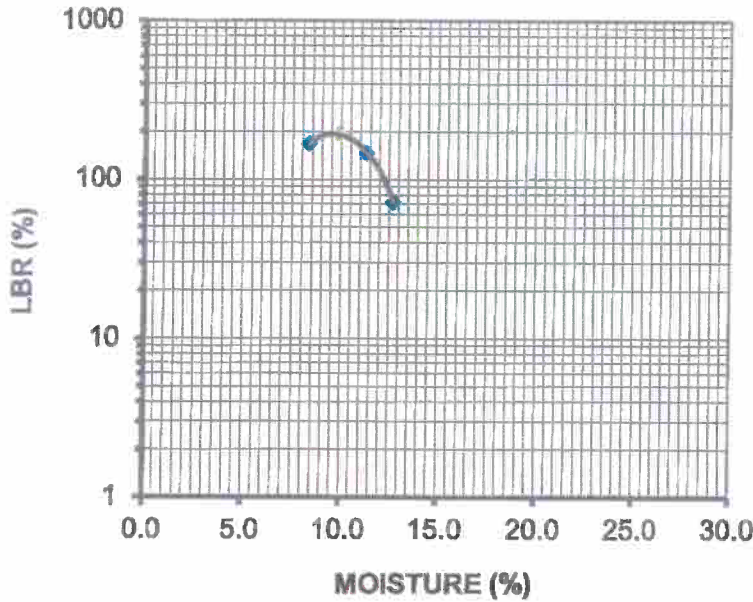

LBR TEST NO: 176

COMPACTION TEST NO.: 204

MAXIMUM LBR VALUE (%): 192

MAXIMUM DRY DENSITY (PCF): 119.1

OPTIMUM MOISTURE (%): 10.3

DATE RECEIVED: 12/21/18

DATE TESTED: 12/26/18

LOCATION SAMPLED: Stockpile

SOIL DESCRIPTION: Crushed Concrete


TYPE OF MATERIAL: Base

SOAKING TIME (HRS): 48±4

SOAKING SURCHARGE (LBS): 2.5

TESTING SURCHARGE (LBS): 0

REMARKS:

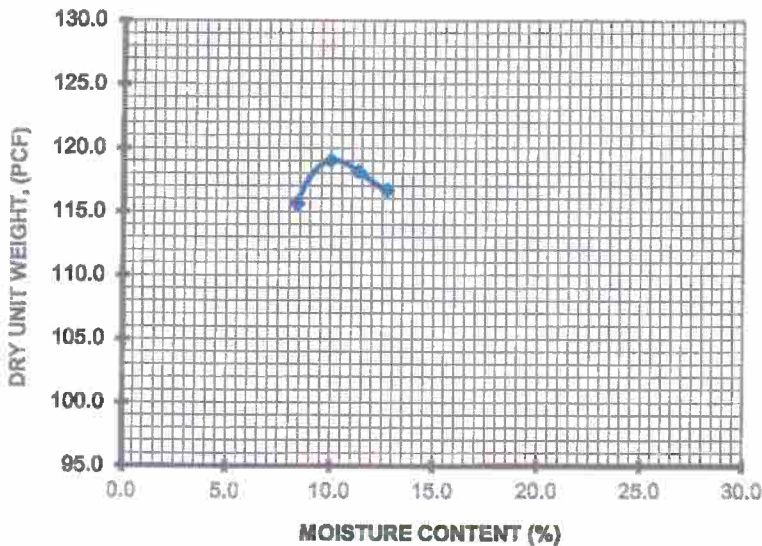

This report contains information that is intended solely for the use of the client and not for any other purpose. This report shall not be reproduced, except in full, without written approval of TestLab, Inc.