


RESULTS OF LABORATORY TESTING

Project Name: Transcor Recycling Laboratory Testing
Client: Transcor Recycling, LLC
AREHNA Project No.: M-18-009

Lab No.: AS1645
Sampled Date: 2/7/2018
Report Date: 2/12/2018

Limerock Bearing Ratio Test Results

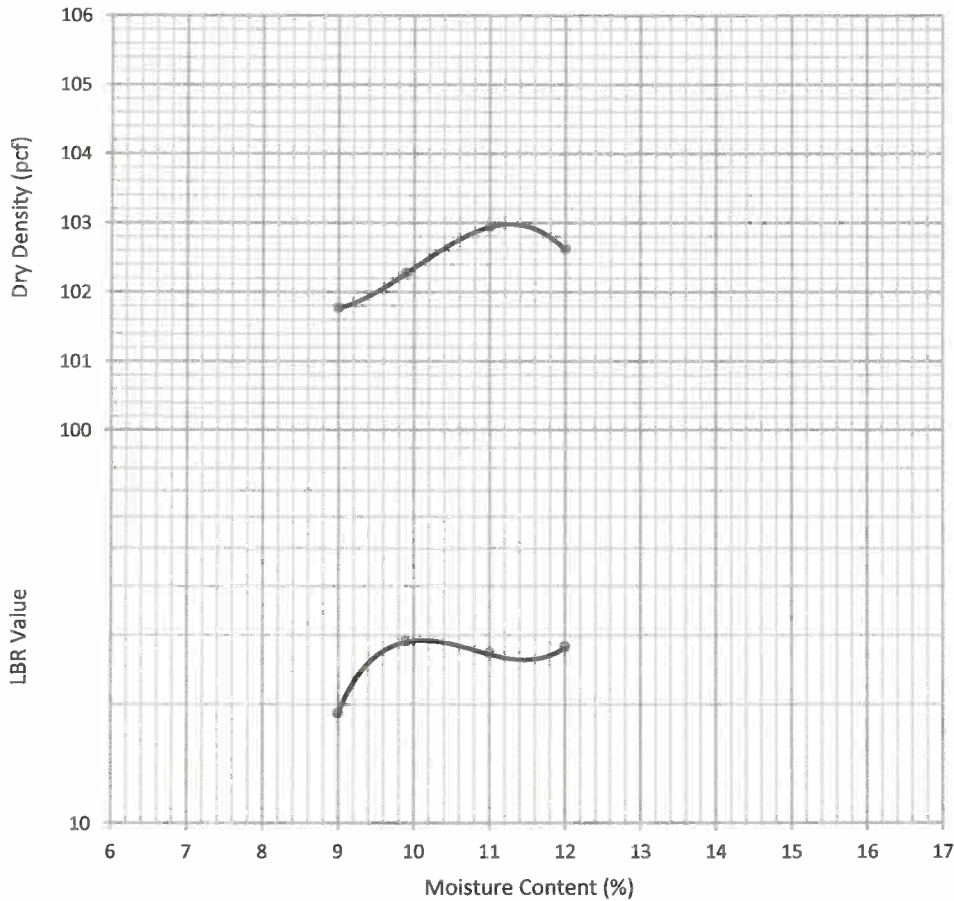

Material Information

Test Method: FDOT FM5-515
 Max. Dry Density: 103 pcf
 Optimum Moisture: 11.3 %
 LBR Value: 29

Tested By: Schmitz, A.
 % passing #4 Sieve: 100 %
 % passing #200 Sieve: 3.18 %

Avg. Organic Content: 0.4 %
 Liquid Limit: NP
 Plastic Limit: NP
 Plasticity Index: NP

Sample Location: Stockpile
 Sample Description: Pale Orangish-Brown Fine Sand



Stephen Long, EI
 Project Manager

Respectfully Submitted,
AREHNA Engineering, Inc.



Amanda S
 Pereira
 2018.02.22
 13:34:15 -05'00'

Amanda S. Pereira, PE
 Fla. Registration No. 67784