



GEOTECHNICAL & MATERIALS
 ENGINEERING, TESTING & INSPECTION
 P.O. BOX 15732 • TAMPA, FLORIDA 33684 • 813/872-7821 CA No. 1450

PROJECT: Product Check - P.O. No. 7001-95000
 53rd Street Yard

PROJECT NO: TL-8047

CLIENT: Transcor Recycling LLC

DATE: 8/27/2018

LAB NO.: B-11235


SAMPLE LOCATION: Stockpile

SAMPLE DESCRIPTION: Crushed Concrete (County Road Base - 1" minus)
 (Base Material)

<u>Sieve Number</u>	<u>Percent Passing</u>	<u>Material Type B-12 FDOT Specifications Uncertified</u>
1½"	100	100
1	100	---
¾"	95	65-95
⅜"	80	40-85
No. 4	64	25-65
No.10	49	20-50
No. 50	31	5-30
No. 100	15	---
No. 200	6.2	0-10

DATE SAMPLED: 10/26/18

DATE TESTED: 11/2/18



Digitally signed
 by Shannon R
 Snyder
 Date: 2018.11.09
 10:35:23 -05'00'

SHANNON R. SNYDER, P.E.
 Florida License No. 57019

PROJECT: Product Check - P.O. No. 7001-95000
 53rd St. Yard

CLIENT: Transcor Recycling LLC


LIMEROCK BEARING RATIO TEST

TEST METHOD: FDOT FM 5-515

PROJECT NO: TL-8047

DATE: November 5, 2018

LAB NO: B-11307

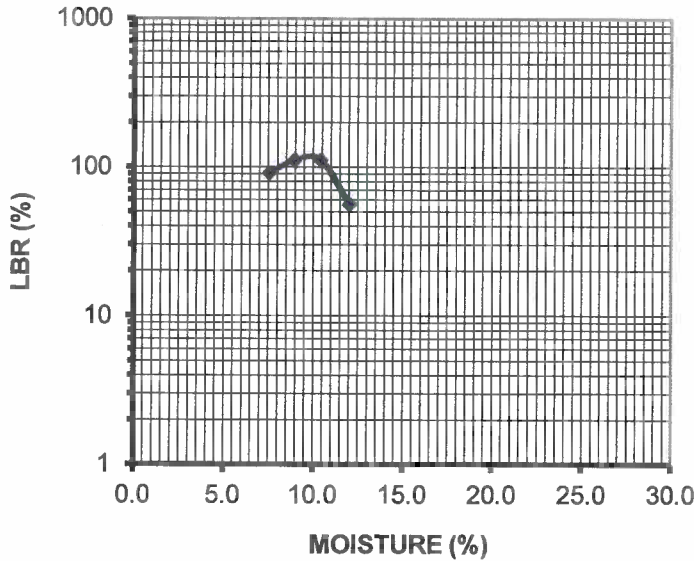

MAXIMUM LBR VALUE (%): 114

MAXIMUM DRY DENSITY (PCF): 118.7

OPTIMUM MOISTURE (%): 9.9

DATE RECEIVED: 10/26/18

DATE TESTED: 10/31/18

LOCATION SAMPLED: Stockpile

SOIL DESCRIPTION: Crushed Concrete
 (County Road Base - 1" minus)


TYPE OF MATERIAL: Base

SOAKING TIME (HRS): 48±4

SOAKING SURCHARGE (LBS): 2.5

TESTING SURCHARGE (LBS): 0

REMARKS:

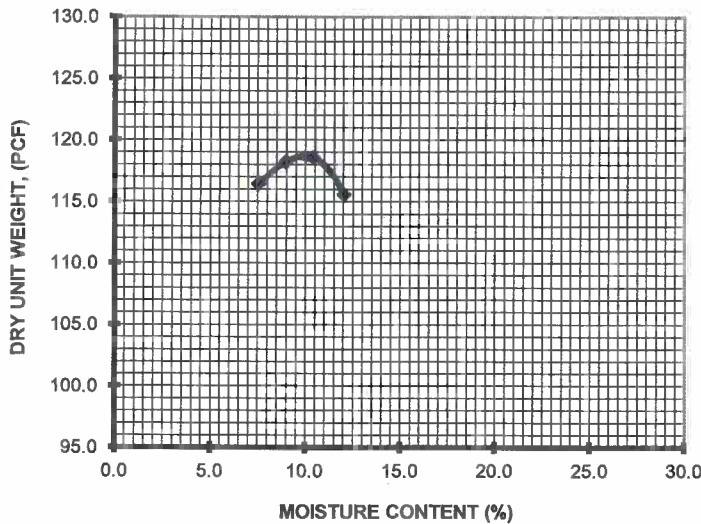

Digitally signed
 by Shannon R
 Snyder
 Date: 2018.11.09
 10:34:41 -05'00'

SHANNON R. SNYDER, P.E.

Florida License No. 57019

This report contains information that is intended solely for the use of the client and noted assigns.
 This report shall not be reproduced, except in full, without written approval of Test Lab, Inc.