

PROJECT: Product Check - P.O. No. 7001-95000
 53rd St. Yard


CLIENT: Transcor Recycling LLC

LIMEROCK BEARING RATIO TEST
 TEST METHOD: FDOT FM 5-515

PROJECT NO: TL-8047

DATE: March 27, 2020

LAB NO: B-11995

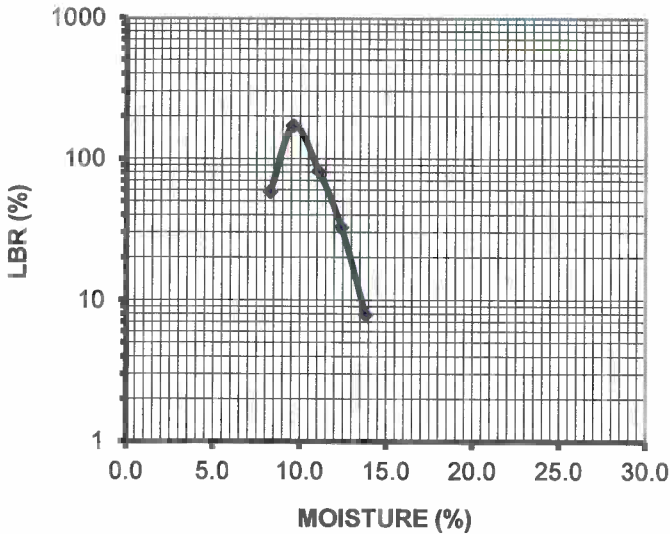

MAXIMUM LBR VALUE (%): 172

MAXIMUM DRY DENSITY (PCF): 120.3


OPTIMUM MOISTURE (%): 10.2

DATE RECEIVED: 03/19/20

DATE TESTED: 03/27/20

LOCATION SAMPLED: Stockpile

SOIL DESCRIPTION: Crushed Concrete Fines

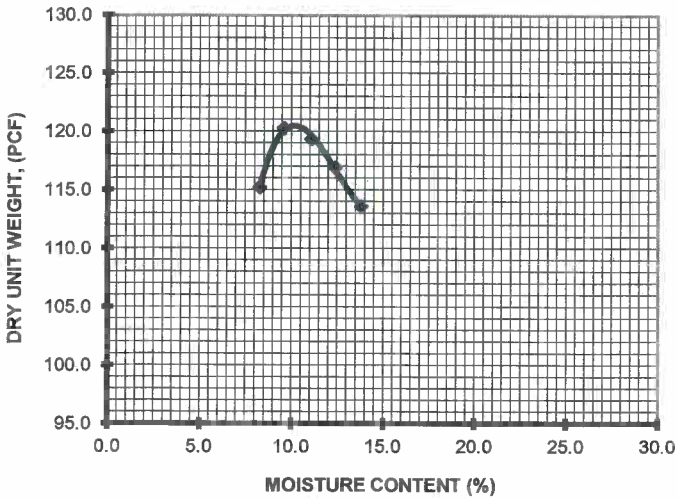


TYPE OF MATERIAL: Base

SOAKING TIME (HRS): 48±4

SOAKING SURCHARGE (LBS): 2.5

TESTING SURCHARGE (LBS): 0

REMARKS:

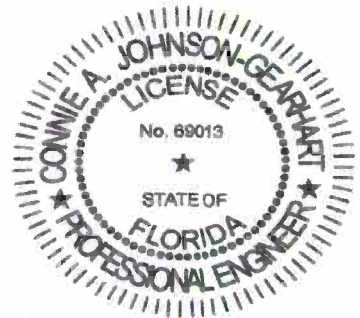

Digitally signed by Connie A Johnson-Gearhart
 Date: 2020.03.27 15:25:26 -04'00'

CONNIE A. JOHNSON-GEARHART, P.E.

Florida License No. 69013

This item has been digitally signed and sealed by Connie A. Johnson-Gearhart, P.E. on the date adjacent to the seal
 Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

This report contains information that is intended solely for the use of the client and noted assigns.
 This report shall not be reproduced, except in full, without written approval of Test Lab, Inc.



**GEOTECHNICAL & MATERIALS
ENGINEERING, TESTING & INSPECTION**
P.O. BOX 15732 • TAMPA, FLORIDA 33684 • 813/872-7821 CA No.1450

SIEVE ANALYSIS

PROJECT: Product Check - P.O. No. 7001-95000
53rd St. Yard

CLIENT: Transcor Recycling LLC

PROJECT NO: TL-8047

DATE: 3/27/2020

LAB NO.: B-11995


SAMPLE LOCATION: Stockpile

SAMPLE DESCRIPTION: Crushed Concrete Fines

<u>Sieve Number</u>	<u>Percent Passing</u>
1 1/2"	100
3/4"	99
3/8"	92
No. 4	75
No. 10	61
No. 50	36
No. 100	19
No. 200	9.0

DATE SAMPLED: 3/19/20

DATE TESTED: 3/27/20

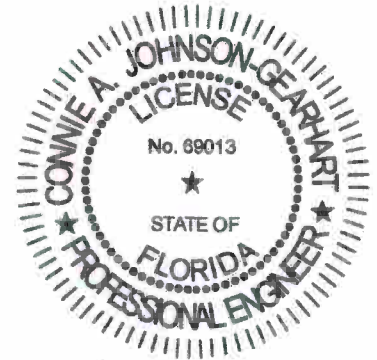

Digitally signed by Connie A Johnson-Gearhart
Date: 2020.03.27 14:35:45 -04'00'

CONNIE A. JOHNSON-GEARHART, P.E.
Florida License No. 69013

This item has been digitally signed and sealed by Connie A. Johnson-Gearhart, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies